

# **VOICE SYNTHESISER TYPE VS2**

## **INTRODUCTION**

The VS2 Voice Synthesiser System comprises of a Controller Interface Module (fitted in the lift controller, which has integral control with the TC3 Digital Indicator range), and a Voice Synthesiser fitted on the lift car or landings.

The Controller Interface Module will support upto 64 digital indicator or Voice Synthesiser units. The Voice Synthesiser Unit can announce upto 32 floor references (which are site programmable within the standard voice library constraints), direction status, door status, and 3 messages.

### ***Voice Synthesiser Unit Features***

Intelligent selection of 32 floor announcements, direction status, door status, and 3 message announcements.

Uses latest developments of circuit integration together with surface mount manufacturing techniques to give a unit footprint of 75mm. x 65mm. and 20mm deep.

Utilises CAN communications to reduce site wiring and ease installation (2 wires for power and 2 wires for communications).

The Output Audio is via a 8 ohm speaker at 1 watt.

### ***Controller Interface Unit Features***

Incorporates Liquid Crystal Display to monitor and program the Digital Indicator and Voice Synthesiser operation.

Floor Identities are site programmable into NVRAM with no special equipment required provided the floor announcements are within the standard announcement library.

Inputs are opto-isolated for 24Vdc operation and include :-

Binary position inputs PA, PB, PC, PD, PE, PF for upto 32 floors.

SX input for Speech Position Data Announcement control

IU, ID, HL inputs for Hall Lantern Announcement control.


DC, DO inputs for door open and close announcements.

OS, OL, FC for messages.

Note: A decimal to binary encoder unit is available as an optional chargeable extra to help controller position data interfacing.

# VOICE SYNTHESISER TYPE VS2

## VOICE SYTHESISER CONNECTION DIAGRAM

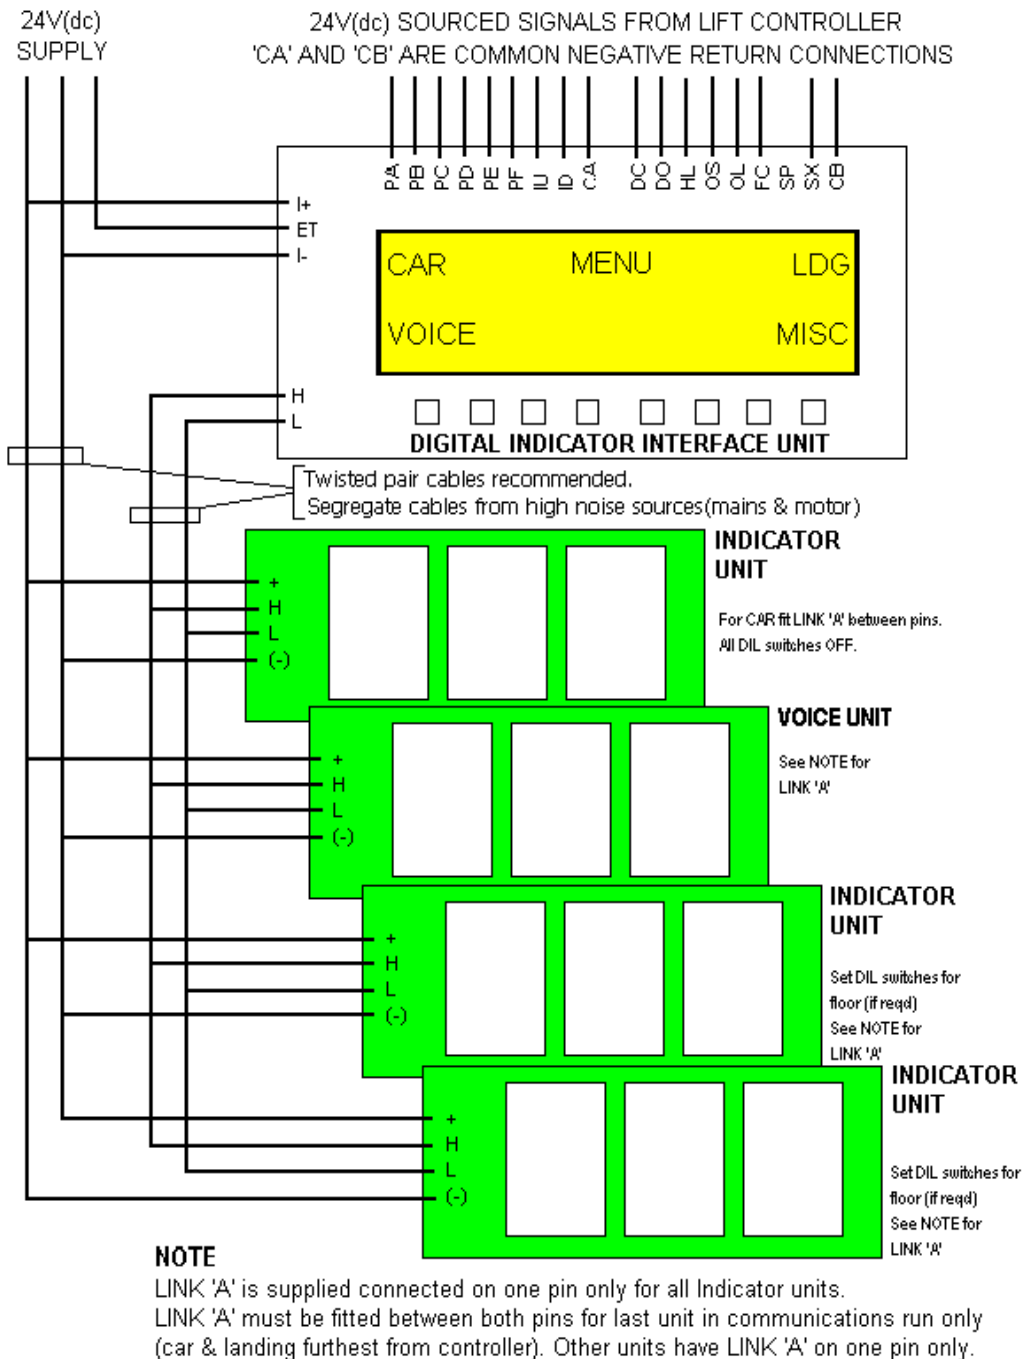

PA,PB,PC,PD,PE,PF \_\_\_\_\_ POSITION INPUTS (BINARY)  
IU,ID,HL \_\_\_\_\_ HALL LANTERN CONTROL INPUTS  
DC,DC \_\_\_\_\_ DOOR OPEN / CLOSE CONTROL INPUTS  
OL,OS,FC \_\_\_\_\_ MESSAGE INPUTS (overload, out of service, fire)  
SX \_\_\_\_\_ SPEECH CONTROL (silence position statement)

## **VOICE SYNTHESISER TYPE VS2**

### **INTERFACE UNIT CONTROLS**

Following power initialisation the system is set to the 'main menu' operation to give a display as follows :-

CAR	MENU	LDG
VOICE		MISC

### **PUSH BUTTON FUNCTIONS**

<i>Left Arrow</i> _____	Shifts cursor one field to left
<i>Right Arrow</i> _____	Shifts cursor one field to right
<i>Up Arrow</i> _____	Shifts cursor up one line
<i>Down Arrow</i> _____	Shifts cursor down one line
<i>Menu</i> _____	Returns display to Main Menu Screen
<i>RTN</i> _____	Selects / terminates function or instruction
<i>SET</i> _____	Selects Position Floor Reference Setup operation
<i>SAVE</i> _____	Selects saving of Floor Reference Data

To show the data displayed by the voice synthesiser push cursor left once, then cursor down one, then push return once to give display as follows :-

P=01	^VOICE^	D=SB
-----CAR OVERLOADED-----		

This shows the data regarding the Voice Synthesiser as having an absolute position of floor '01' (bottom), an announced position of 'SB', an Up direction and hall lantern operational, and a 'Car Overloaded' message displayed.

To return to the 'Main Menu' press 'Menu' push.

## **VOICE SYNTHESISER TYPE VS2**

### **SETTING THE FLOOR REFERENCES**

The Floor References corresponding to the absolute lift position (floor 1 as bottom) may be programmed on site with no special equipment required. To enter the position reference setup operation press 'SET' push to give the following display :-

P=01	D=SB
SET DISPLAY DATA	

Use the UP or DOWN ARROW to increase or decrease the absolute position to the required floor.

Push the RIGHT ARROW to shift to the displayed position (left hand character).

Use the UP or DOWN arrow to set the character to +, -, space, or any numeric or alphabetic character (push may be held down to scroll).

Push the RIGHT ARROW to shift to the displayed position (right hand character).

Use the UP or DOWN arrow to set the character.

Press SAVE push to save the data.

The display will respond by showing 'save ?' on the top line centre.

Press SAVE push again to confirm.

The display will respond by showing 'saving' on the top line centre.

After a few seconds the display will show 'saved !' on the top line centre.

The data for the set entry is now set in NVRAM (held even if the supply is switched off).

After a few further seconds the display will return to the set display data screen shown above.

The procedure may be repeated for further floor entries or the MENU push may be pressed to return to the basic MENU screen.

If in doubt at any time press the MENU button to recover back to the MENU screen.

## **VOICE SYNTHESISER TYPE VS2**

### **VOICE SYNTHESISER OPERATION**

A CAN link is used to transfer data between the Interface Unit and the Voice Synthesiser. LED indicators are illuminated on the Voice Synthesiser PCB to show :-

- S \_\_\_\_\_ 5Vdc power supply monitor.
- R \_\_\_\_\_ Receive data monitor for CAN link (raw CAN data).
- C \_\_\_\_\_ Communications confirmation monitor for CAN Data.
- B \_\_\_\_\_ Busy signal illuminated when the speech controller is engaged in sending a voice statement.

‘C’ indicator shows the data has been received correct following integrity checks.

During NORMAL operation led status should be :-

- S \_\_\_\_\_ illuminated constantly
- R \_\_\_\_\_ pulsing at approximately 0.25 second intervals
- C \_\_\_\_\_ pulsing at approximately 1 second intervals.
- B \_\_\_\_\_ pulses while an announcement is spoken.

Although the CAN link is reasonably noise immune, the unit wiring should be segregated from sources of high electrical noise such as heavy mains or motor wiring. Initial recommendations are to use twisted pairs for communications and supply wires, or screened cable where noise problems are experienced.

### **DIL SWITCH SETTINGS**

A 4 way dil switch is fitted on the Voice Synthesiser PCB to set the type of usage.

- DIL switch 1 \_\_\_\_\_ OFF = inhibit gong up and down chime statements  
ON = enable gong chime operation
- DIL switch 2 \_\_\_\_\_ OFF = inhibit going up and going down statements  
ON = enable going up and going down statements
- DIL switch 3 \_\_\_\_\_ OFF = enable doors opening and closing statements  
ON = enable please mind the doors statement
- DIL switch 4 \_\_\_\_\_ OFF = enable silence control  
ON = disable silence operation

### **POWER SUPPLY REQUIREMENTS**

- Voice Unit* \_\_\_\_\_ 24Vdc smoothed at 0.25A
- Interface Unit* \_\_\_\_\_ 24Vdc smoothed at 0.5A

### **STANDARD VOICE ANNOUNCEMENT LIBRARY**

SB	Sub Basement Floor	0, 1 to 32	Numeric Floor
LB	Lower Basement Floor	-1 to -5	Minus Numeric Floor
UB	Upper Basement Floor	CP	Car Park Floor
B	Basement Floor	L	Lobby Floor
LG	Lower Ground Floor	M	Mezzanine Floor
UG	Upper Ground Floor	PH	Penthouse Floor
G	Ground Floor	R	Reception Floor

## **VOICE SYNTHESISER TYPE VS2**

### **VOICE SYTHESISER CONTROLS**

#### *Position Control*

Position statements are announced once only each time the position changes.

The 'SX' input may be energised to inhibit position statements (possibly while travelling between floors via a normally open HSR contact).

Position statements will only be announced providing the Position Indicator Display character has a match within the Voice Synthesiser Statement Library. Special contract specific Voice Libraries are available on request at extra cost.

#### *Door Control*

The unit will either announce 'doors opening / closing' or 'please mind the doors' dependent upon DIL Switch settings.

'Please mind the doors' statement is only made on closing.

Since continual repetition of door control statements may be considered a nuisance when used in residential environments, door statements may be automatically silenced if more than 25 door statements are made at a constant floor position. The voice function will return to normal if a new position statement is invoked, or no door statement requests are made for 2 minutes. This automatic silence function can be inhibited via DIL switch operation, since under certain circumstances it may be considered better to always give door announcements (for the sake of blind passengers). Only 'door' statements are affected by silence control

#### *Direction Control*

The unit will announce either 'going up / down' or one gong for up / two gongs for down, selectable under DIL switch operation. Direction statements will commence under control of the 'HL' input on the Interface Unit, and the 'doors opening' statement. Primarily 'direction' statements are enabled only after the 'door open' statement is given at a floor. Once enabled all direction statements are given until they are inhibited via the change of the lift position. In order to register a direction statement the 'Interface Unit' must receive an 'HL' input together with an 'IU or ID' input.

#### *Message Control*

Standard Messages are available for Fire Control, Lift Out of Service, and Car Overloaded.

When a new message is invoked it is announced once only. A 'no message' signal will recycle the message announcement control.